


INSTALLATION INSTRUCTIONS


DPK 22/4 Ex

Installation in ventilation ducts

DPK-Ex within a channel system.

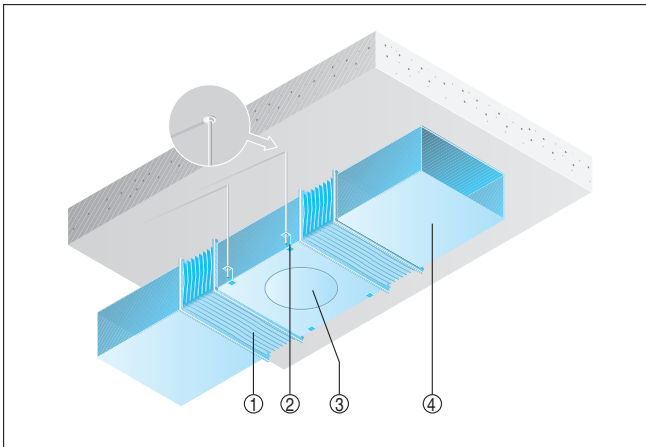


- ① ELP-Ex flexible coupling
- ② Mounting component, to be supplied by the customer
- ③ DPK-Ex fan
- ④ Ventilation channel, to be supplied by the customer

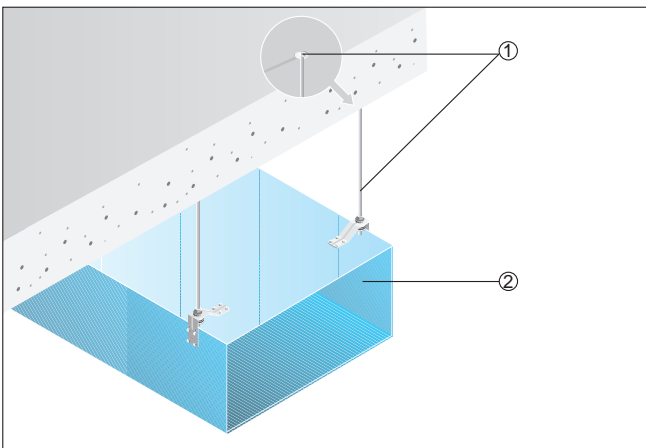

- ① Mounting components and material, to be supplied by the customer
- ② Ventilation channel, to be supplied by the customer

Installation example

Rectangular ventilation channel with mounting components for ceiling assembly. Mounting components and material must be provided by the customer.

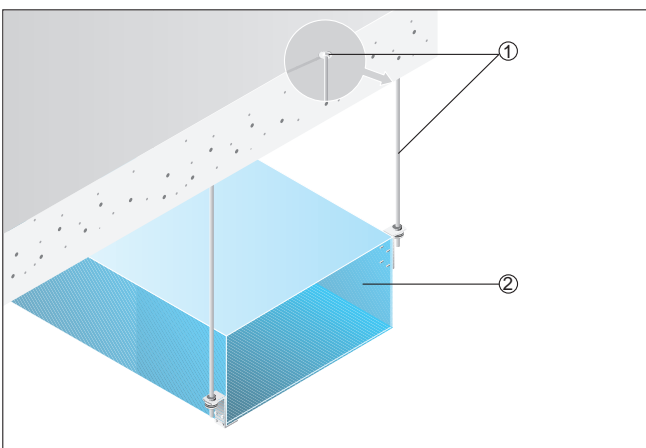

INSTALLATION INSTRUCTIONS



DPK 22/4 Ex

- ① Mounting components and material, to be supplied by the customer
- ② Ventilation channel, to be supplied by the customer